

INSTRUMENT CATHODE-RAY TUBE

development sample data

18 cm diagonal, rectangular flat faced oscilloscope tube with mesh and metal backed screen.

QUICK REFERENCE DATA

Final accelerator voltage	$V_{g7(\ell)}$	10	kV
Display area		120 x 100	mm ²
Deflection factor, horizontal	M_x	approx. 16	V/cm
vertical	M_y	approx. 5	V/cm

Blue Binder, Tab 4

SCREEN: Metal backed phosphor

	colour	persistence
D18-120GH	green	medium short

Useful screen dimensions min. 120 x 100 mm²

Useful scan at $V_{g7(\ell)}/V_{g2, g4} = 5$

horizontal min. 120 mm

vertical min. 100 mm

Spot eccentricity in horizontal and vertical directions 6 mm


HEATING: Indirect by A.C. or D.C.; parallel supply

Heater voltage	V_f	6.3	V
Heater current	I_f	300	mA

These data, based on the specifications and measured performance of development samples, afford a preliminary indication of the characteristics to be expected of the described product. Distribution of development samples implies no guarantee as to the subsequent availability of the product

MECHANICAL DATA

Dimensions in mm

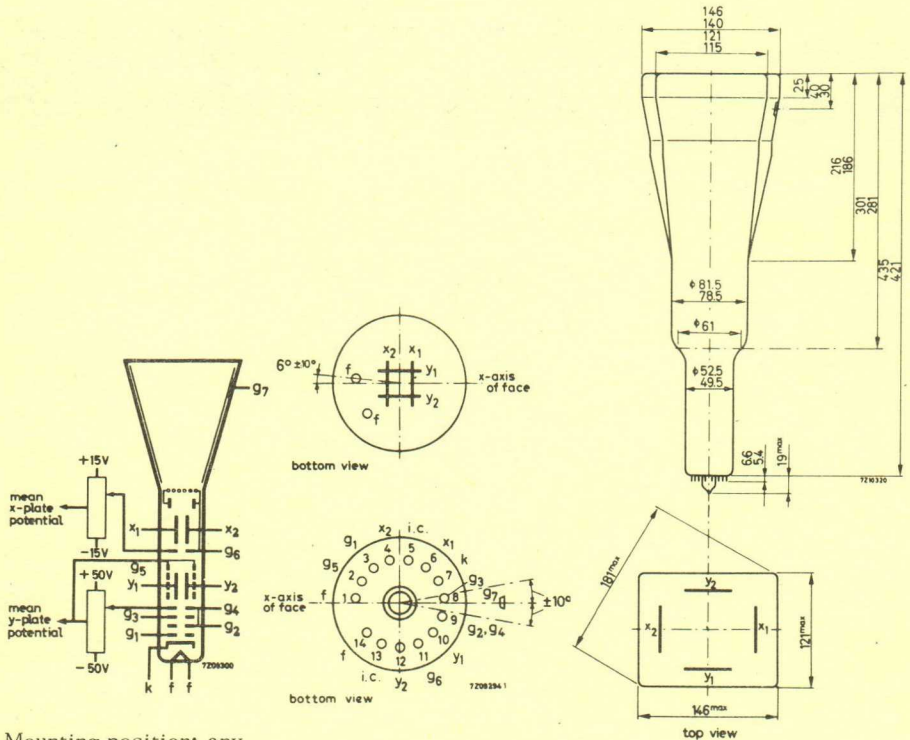

Mounting position: any

The tube should not be supported by the base alone and under no circumstances should the socket be allowed to support the tube.

Dimensions and connections

See also outline drawing

Overall length (socket included)

max. 454 mm

Face dimensions

max. 146 x 121 mm²

Net weight

approx. 1300 g

Base

14 pin all glass

Accessories

Socket (supplied with tube)

type 55566

Final accelerator contact connector

type 55563

Mu-metal shield

type 55584

CAPACITANCES

x_1 to all other elements except x_2	$C_{x_1(x_2)}$	5 pF
x_2 to all other elements except x_1	$C_{x_2(x_1)}$	5 pF
y_1 to all other elements except y_2	$C_{y_1(y_2)}$	4 pF
y_2 to all other elements except y_1	$C_{y_2(y_1)}$	4 pF
x_1 to x_2	$C_{x_1x_2}$	3 pF
y_1 to y_2	$C_{y_1y_2}$	2 pF
Control grid to all other elements	C_{g_1}	6 pF
Cathode to all other elements	C_k	5 pF

FOCUSING electrostatic**DEFLECTION** double electrostatic

x plates symmetrical

y plates symmetrical

If use is made of the full deflection capabilities of the tube the deflection plates will intercept part of the electron beam; hence a low impedance deflection plate drive is desirable.

Angle between x and y traces $90 \pm 1^\circ$ Angle between x trace and the horizontal axis of the face max. 5° ¹⁾**LINE WIDTH**

Measured with the shrinking raster method in the centre of the screen under typical operating conditions, adjusted for optimum spot size at a beam current $I_b = 10 \mu A$.

Line width l.w. approx. 0.50 mm

¹⁾ See page 5

TYPICAL OPERATING CONDITIONS

Final accelerator voltage	$V_{g7(\ell)}$		10000	V
Interplate shield voltage	V_{g6}		2000	V
Geometry control voltage	ΔV_{g6}		± 15	V ²⁾
Deflection plate shield voltage	V_{g5}		2000	V ³⁾
Focusing electrode voltage	V_{g3}	approx.	425	V
First accelerator voltage	$V_{g2, g4}$		2000	V
Astigmatism control voltage	$\Delta V_{g2, g4}$		± 50	V ⁴⁾
Control grid voltage for visual extinction of focused spot	V_{g1}	approx.	-50	V
Grid drive for 10 μ A screen current		approx.	12	V
Deflection factor, horizontal	M_x	approx.	16	V/cm
vertical	M_y	approx.	5	V/cm
Deviation of linearity of deflection		max.	2	% ⁵⁾
Useful scan, horizontal		min.	120	mm
vertical		min.	100	mm

LIMITING VALUES (Absolute max. rating system)

Final accelerator voltage	$V_{g7(\ell)}$	max.	11000	V
		min.	9000	V
Interplate shield voltage and geometry control electrode voltage	V_{g6}	max.	2200	V
Deflection plate shield voltage	V_{g5}	max.	2200	V
Focusing electrode voltage	V_{g3}	max.	2200	V
First accelerator and astigmatism control electrode voltage	$V_{g2, g4}$	max.	2200	V
		min.	1350	V
Control grid voltage	$-V_{g1}$	max.	200	V
		min.	0	V
Cathode to heater voltage	V_{kf}	max.	125	V
	$-V_{kf}$	min.	125	V
Voltage between astigmatism control electrode and any deflection plate	$V_{g4/x}$	max.	500	V
	$V_{g4/y}$	max.	500	V
Grid drive, average		max.	20	V
Screen dissipation	W_{ℓ}	max.	3	mW/cm ²
Ratio $V_{g7(\ell)}/V_{g2, g4}$	$V_{g7(\ell)}/V_{g2, g4}$	max.	6.7	

For notes see page 5

Notes

- 1) In order to align the x-trace with the horizontal axis of the screen, the whole picture can be rotated by means of a rotation coil. This coil will have 50 amp. turns for the indicated max. rotation of 5° and should be positioned as indicated in the drawing.
- 2) This tube is designed for optimum performance when operating at a ratio $V_{g7}/V_{g2,g4}$ not higher than 5.
The geometry electrode voltage should be adjusted within the indicated range (values with respect to the mean x-plate potential).
A negative control voltage will cause some pincushion distortion and less background light, a positive control voltage will give some barrel distortion and a slight increase of background light.
- 3) The deflection plate shield voltage should be equal to the mean y-plate potential. The mean x- and y-plate potentials should be equal for optimum spot quality.
- 4) The astigmatism control electrode voltage should be adjusted for optimum spot shape. For any necessary adjustment its potential will be within the stated range.
- 5) The sensitivity at a deflection of less than 75% of the useful scan will not differ from the sensitivity at a deflection of 25% of the useful scan by more than the indicated value.